

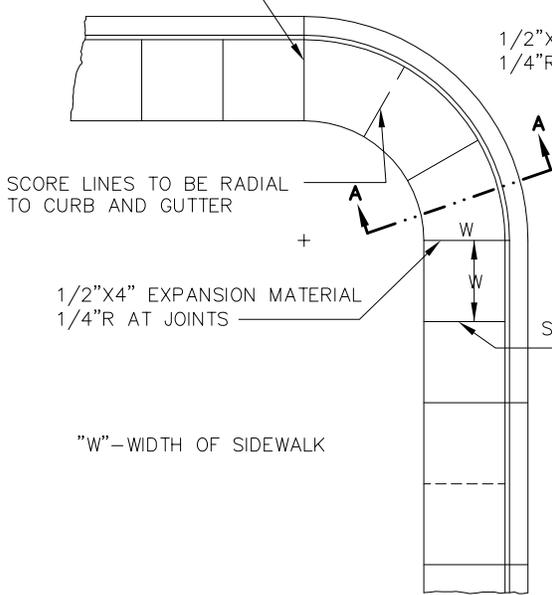



1/2"x4" EXPANSION MATERIAL
1/4"R AT JOINTS

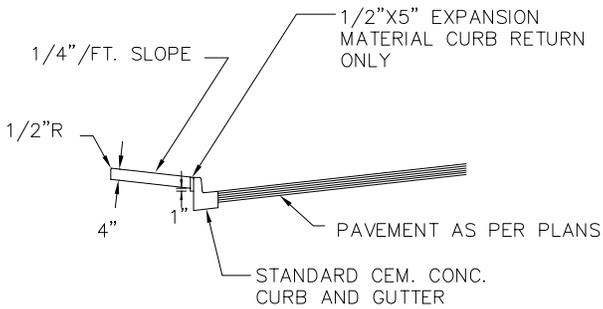

1/2"x4" EXPANSION MATERIAL
1/4"R AT JOINTS

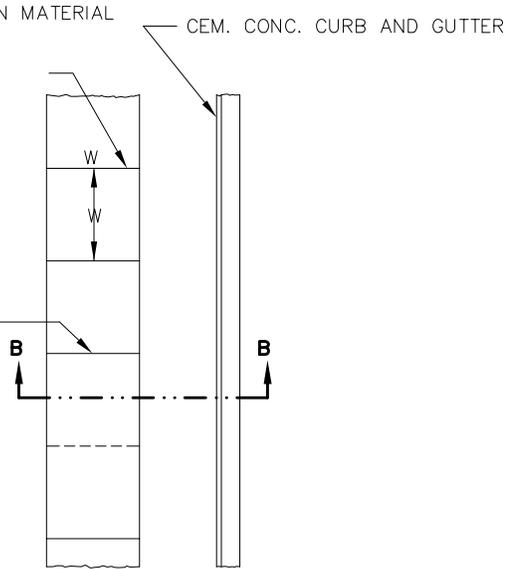

SECTION A-A

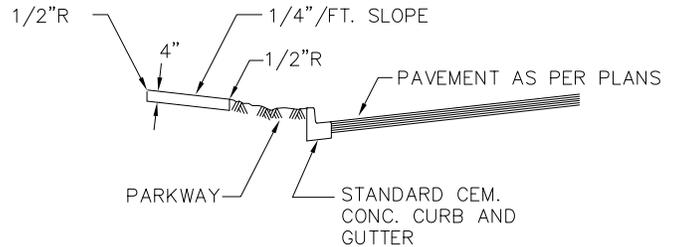

SECTION B-B

SEE SHEET 2.5.1 FOR ROADWAY DEVELOPMENT STANDARDS

GENERAL NOTES:

JOINTS: DUMMY JOINTS SHALL BE PLACED NOT TO EXCEED 15' C/C NOR LESS THAN 10' C/C. THEY SHALL NOT BE LESS THAN 3/16" IN THICKNESS AND SHALL BE EXTENDED 2" BELOW THE GUTTER LINE. 1/2" THRU JOINTS SHALL BE PLACED AT ALL COLD JOINTS AS DIRECTED BY ENGINEER AND SHALL EXTEND 1" BELOW CONCRETE.

WHERE THE SIDEWALK IS TO BE PLACED AGAINST THE CURB AND GUTTER, THE JOINT SHALL BE A COLD JOINT. 1/2"x5" EXPANSION MATERIAL SHALL BE PLACED FROM P.C.'S TO P.T.'S AT ALL CURB RETURNS. 1/2"x4" EXPANSION MATERIAL SHALL BE PLACED AT EVERY FOURTH SIDEWALK PANEL. THE CONCRETE MIX FOR SIDEWALKS SHALL CONFORM TO THE REQUIREMENTS OF CLASS B (3/4") WITH AIR ENTRAINMENT.

THE CONCRETE SHALL HAVE A BROOM FINISH WITH ALL EDGES HAVING A 2 1/2" TOOLED FINISH.

SUBGRADE COMPACTION SHALL BE 90% (MODIFIED PROCTOR).

TYPICAL SIDEWALK

ADOPTED
CITY OF RENTON

STANDARD PLANS
LST DATE: 04/04



DATE	REVISION	BY	APPR'D